

- NOTES**
- This drawing is protected under the Copyright Act, and cannot be used or reproduced in part or in whole without authors consent.
  - All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
  - All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
  - P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
  - All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
  - Water Meter to be 300mm above G.L.
  - D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
  - Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown.
  - All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
  - Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
  - Plinth level to be minimum 300mm from proposed parking level or existing ground level.
  - All surface beds to be cast on well compacted and well consolidated filling.
  - Depth of foundation trenches to be minimum 600mm below reduced ground level.
  - All pipes and services to be minimum 450mm below reduced ground level.
  - All inspection chambers within building area, under building, drive-way parking to be heavy duty double seat air-tight covers, drains pipes encased in 150mm concrete surround.
  - All parking in the Basements is mechanical Parking.

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**

**CLIENT'S SIGNATURE**


P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02)712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR. NO 209/ 3835 ALONG THETA LANE, KILIMANI, NAIROBI FOR ADIZONE REAL ESTATE OF P.O BOX 14314 - 00610

**DRAWING TITLE**  
 BASEMENT 01

**SCALE** 1:161.92

DRG. NO	REVISION
S. 09.1	DATE 11/29/2022
JOB NO	DRAWN G.K
	CHECKED S.K

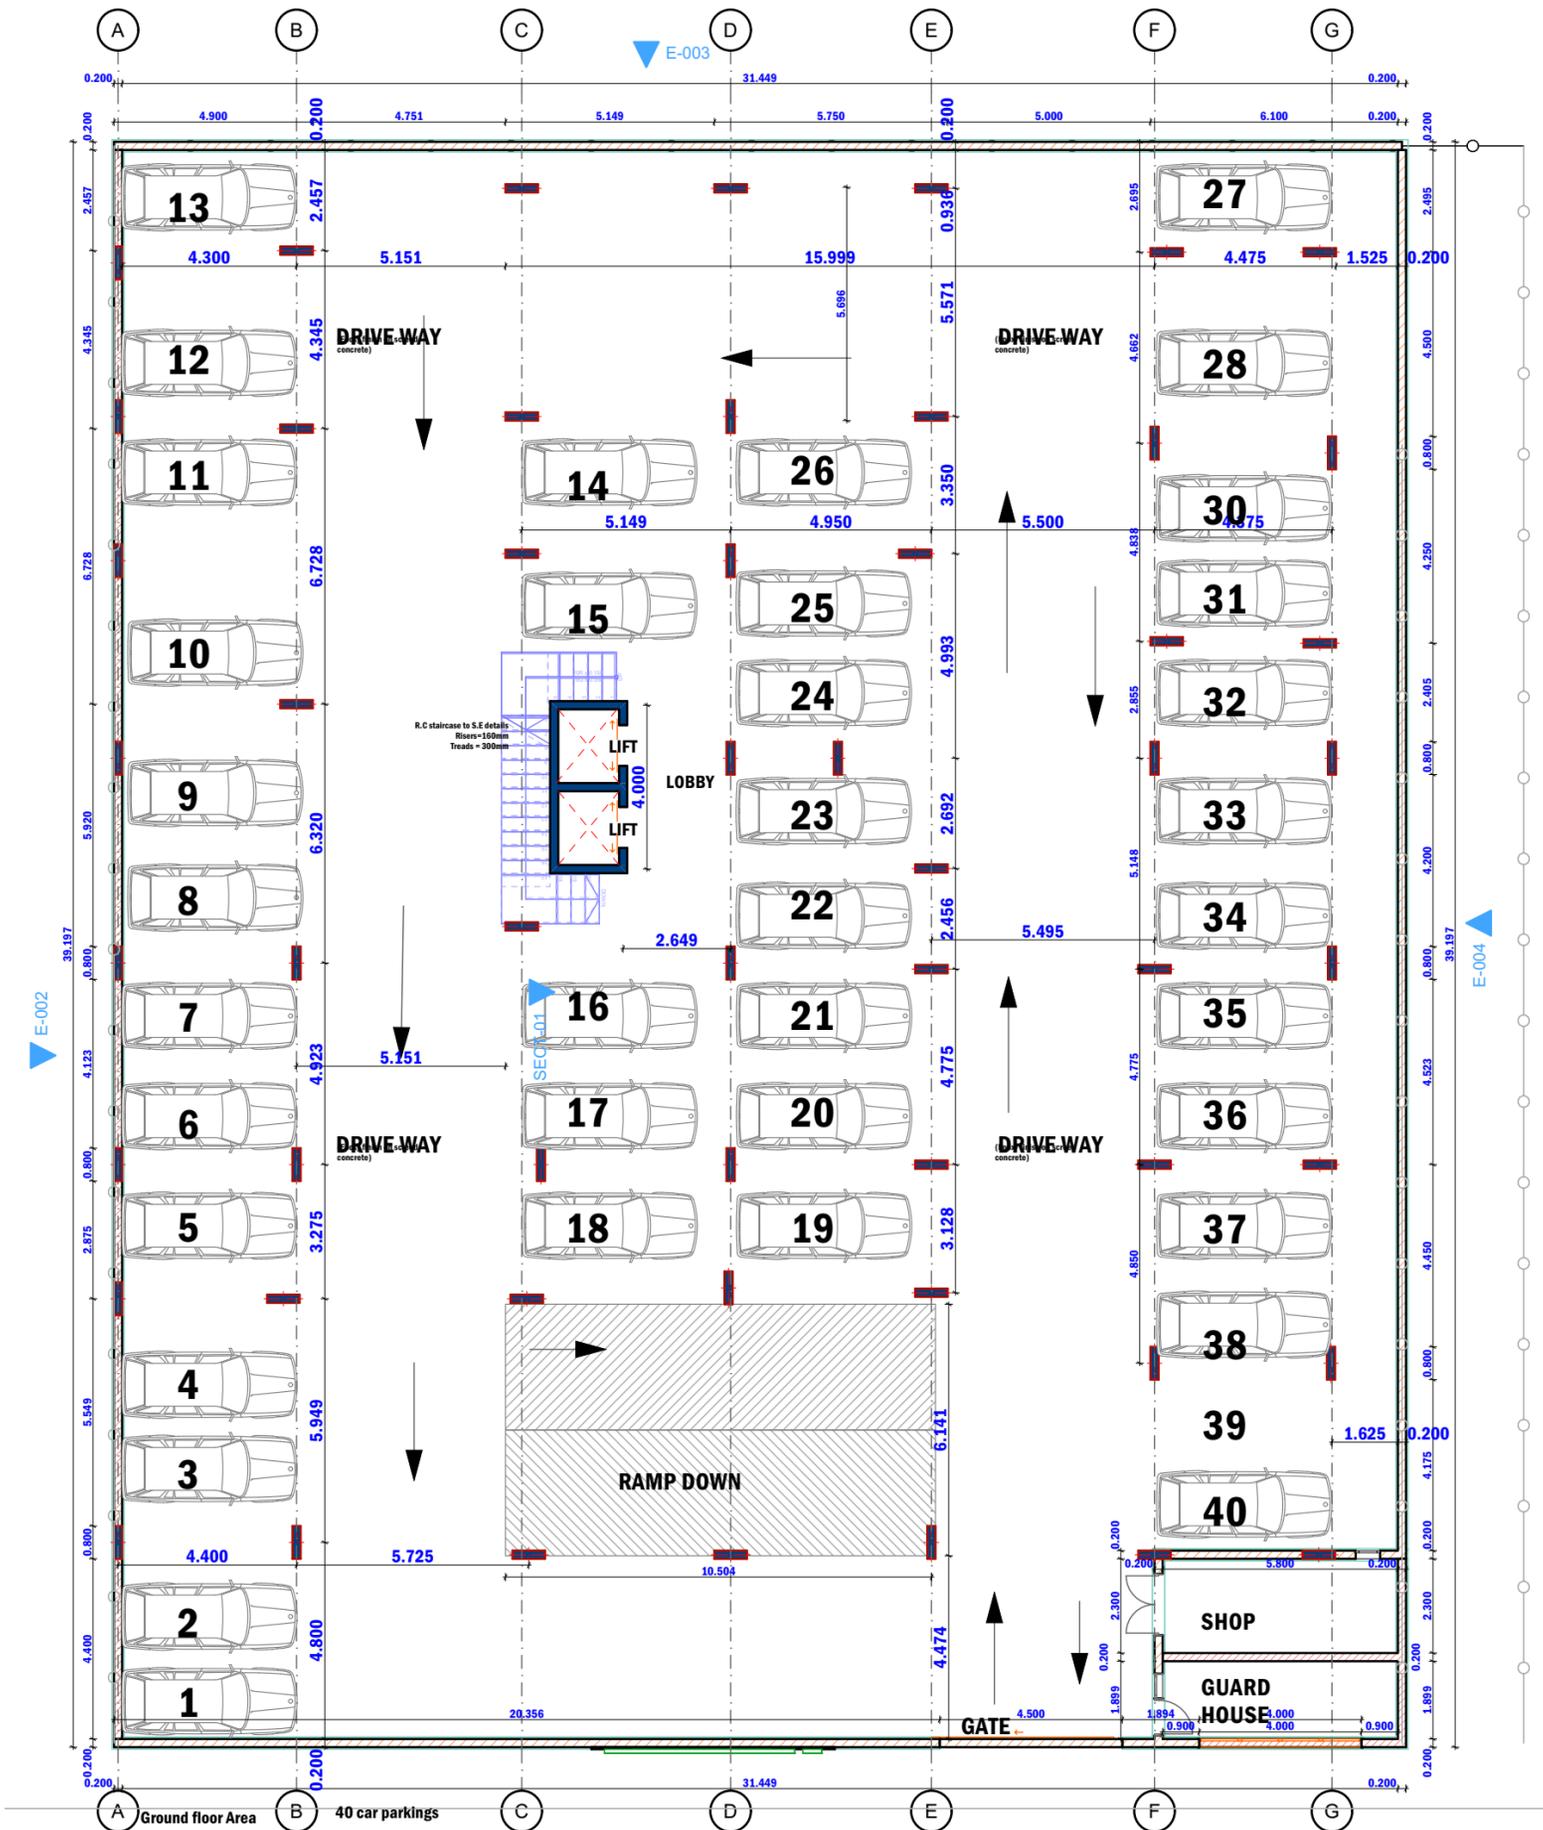

**NOTES**

- 1 This drawing is protected under the Copyright Act, and cannot be used or reproduced in part or in whole without authors consent.
- 2 All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown.
- 9 All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
- 10 Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
- 11 Plinth level to be minimum 300mm from proposed parking level or existing ground level.
- 12 All surface beds to be cast on well compacted and well consolidated filling.
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level.
- 14 All pipes and services to be minimum 450mm below reduced ground level.
- 15 All inspection chambers within building area, under building, drive-way, parking to be heavy duty double seat air-tight covers, drains pipes encased in 150mm concrete surround.
- 16 All parking in the Basements is mechanical Parking.

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**  
 \_\_\_\_\_  
**CLIENT'S SIGNATURE**  
 \_\_\_\_\_

P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02)712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR. NO 209/ 3835 ALONG THETA LANE, KILIMANI, NAIROBI FOR ADIZONE REAL ESTATE OF P.O BOX 14314 - 00610

**DRAWING TITLE**  
 GROUND FLOOR

SCALE 1:159.52

DRG. NO	REVISION
S. 09.1	DATE 11/29/2022
JOB NO	DRAWN G.K
	CHECKED S.K



**NOTES**

- 1 This drawing is protected under the Copyright Act, and cannot be used or reproduced in part or in whole without authors consent.
- 2 All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown.
- 9 All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
- 10 Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
- 11 Plinth level to be minimum 300mm from proposed parking level or existing ground level.
- 12 All surface beds to be cast on well compacted and well consolidated filling.
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level.
- 14 All pipes and services to be minimum 450mm below reduced ground level.
- 15 All inspection chambers within building area, under building, drive-way, parking to be heavy duty double seat air-tight covers, drains pipes enclosed in 150mm concrete surround.
- 16 All parking in the Basements is mechanical Parking

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**

**CLIENT'S SIGNATURE**

P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02)712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**


PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR. NO 209/ 3835 ALONG THETA LANE, KILIMANI, NAIROBI FOR ADIZONE REAL ESTATE OF P.O BOX 14314 - 00610

**DRAWING TITLE**

**1ST FLOOR**

**SCALE 1:158.25**

DRG. NO	REVISION
S. 09.1	DATE 11/29/2022
JOB NO	DRAWN
	G.K
	CHECKED
	S.K

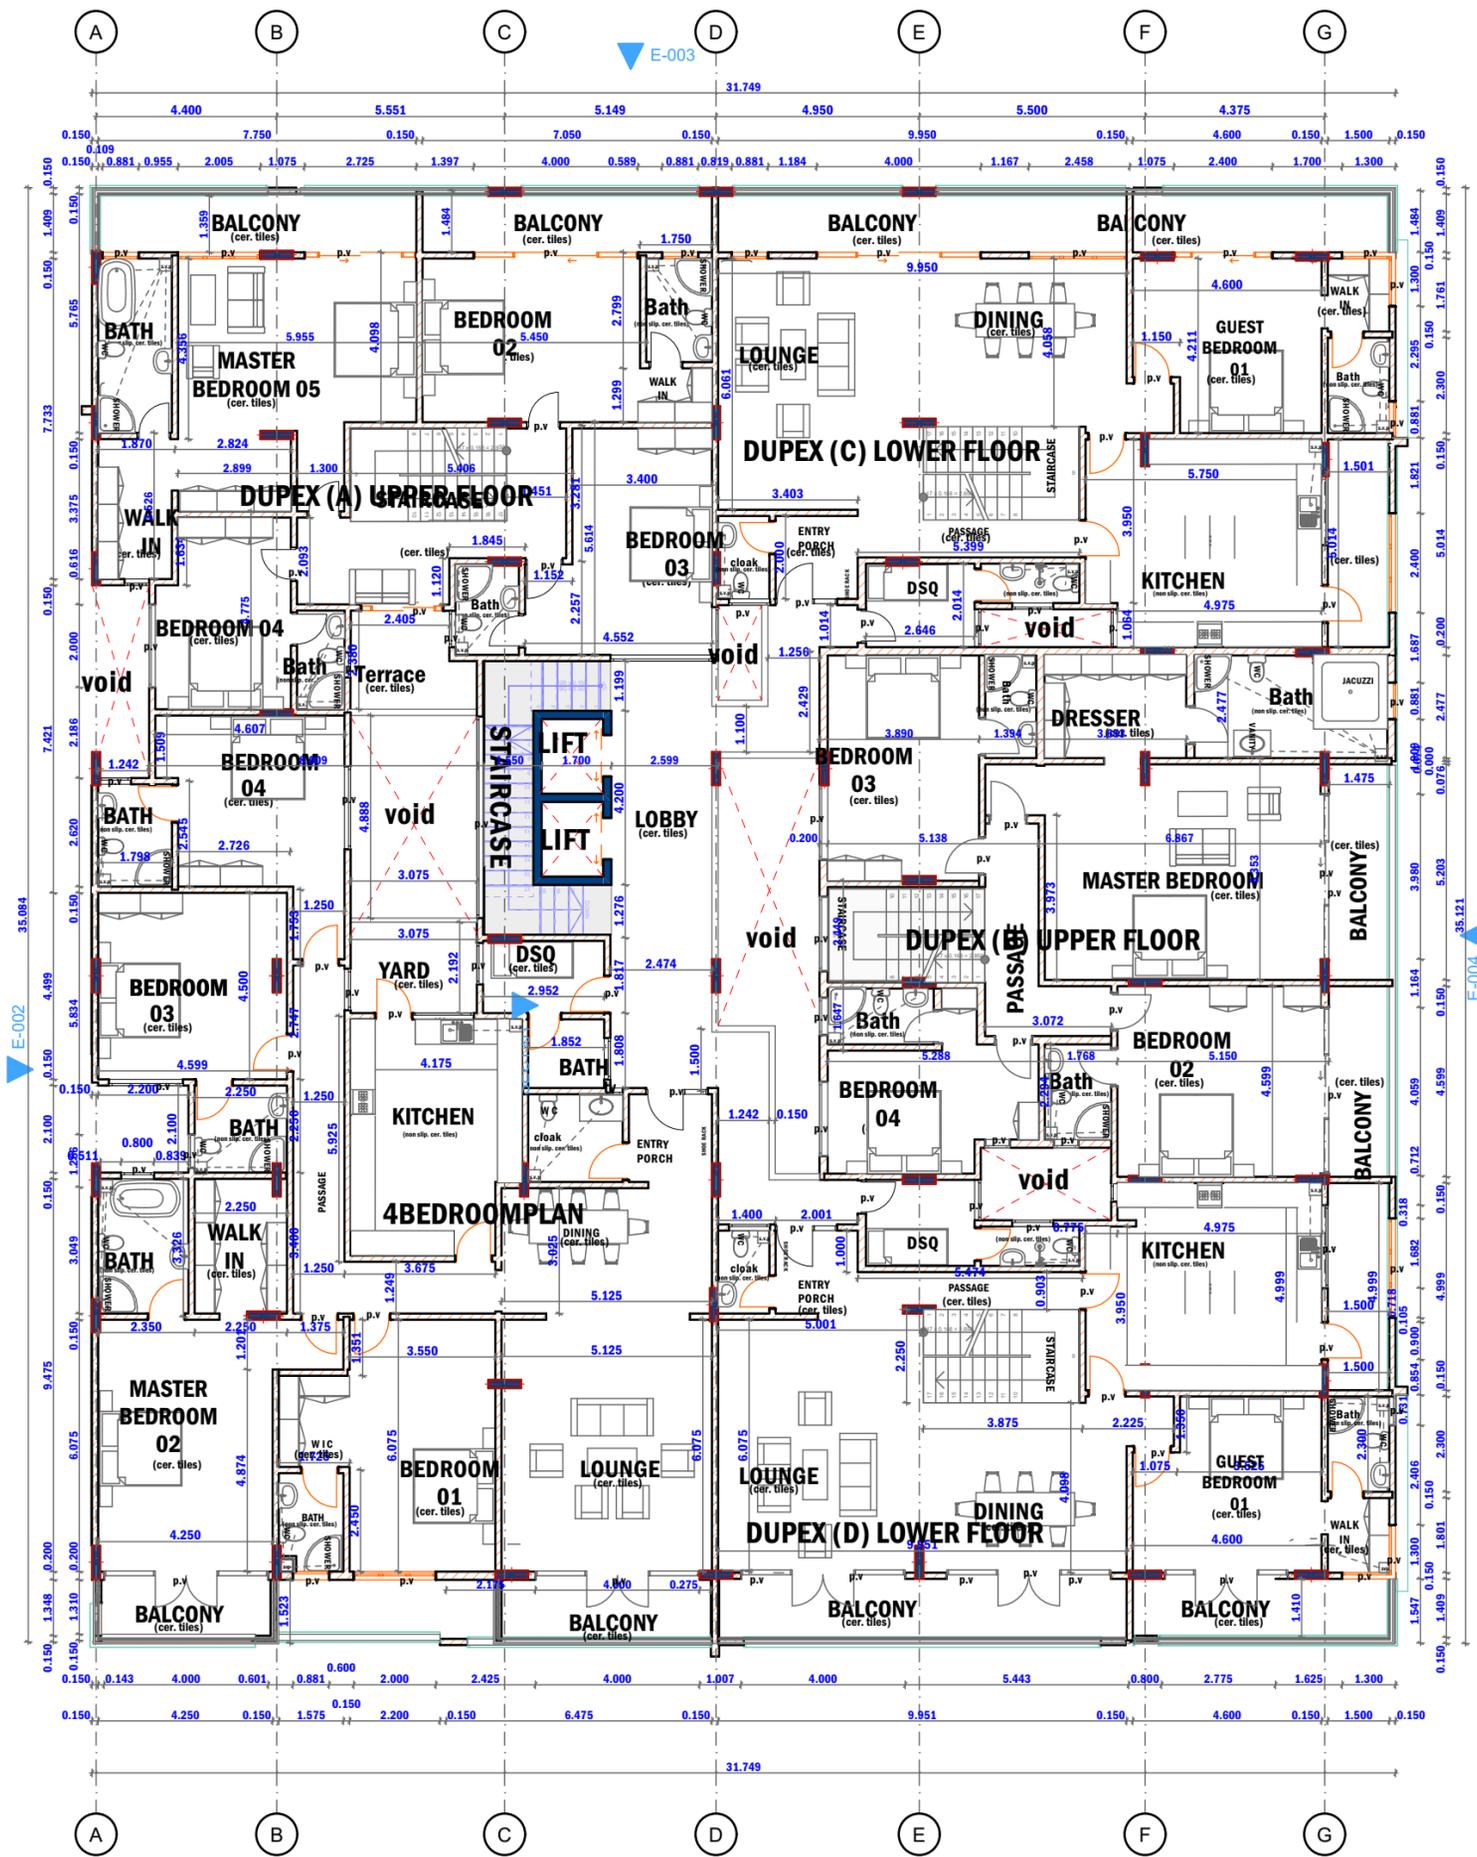

**NOTES**

- 1 This drawing is protected under the Copyright Act and cannot be used or reproduced in part or in whole without authors consent.
- 2 All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 Provide 1 row of 600x60x50mm precast conc paving slabs around the building unless otherwise shown.
- 9 All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
- 10 Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
- 11 Plinth level to be minimum 300mm from proposed parking level or existing ground level.
- 12 All surface beds to be cast on well compacted and well consolidated filling.
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level.
- 14 All pipes and services to be minimum 450mm below reduced ground level.
- 15 All inspection chambers within building area, under building, drive-way parking to be heavy duty double seat air-tight covers, drains pipes enclosed in 150mm concrete surround.
- 16 All parking in the Basements is mechanical Parking.

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**

**CLIENT'S SIGNATURE**


P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02) 712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR. NO 209/ 3835 ALONG THETA LANE, KILIMANI, NAIROBI FOR ADIZONE REAL ESTATE OF P.O BOX 14314 - 00610

**DRAWING TITLE**  
 2ND FLOOR  
 TYPICAL TO  
 4TH, 6TH, 8TH &  
 10TH FLOOR

**SCALE** 1:157.62

DRG. NO	REVISION
S. 09.1	DATE 11/29/2022
JOB NO	DRAWN G.K
	CHECKED S.K

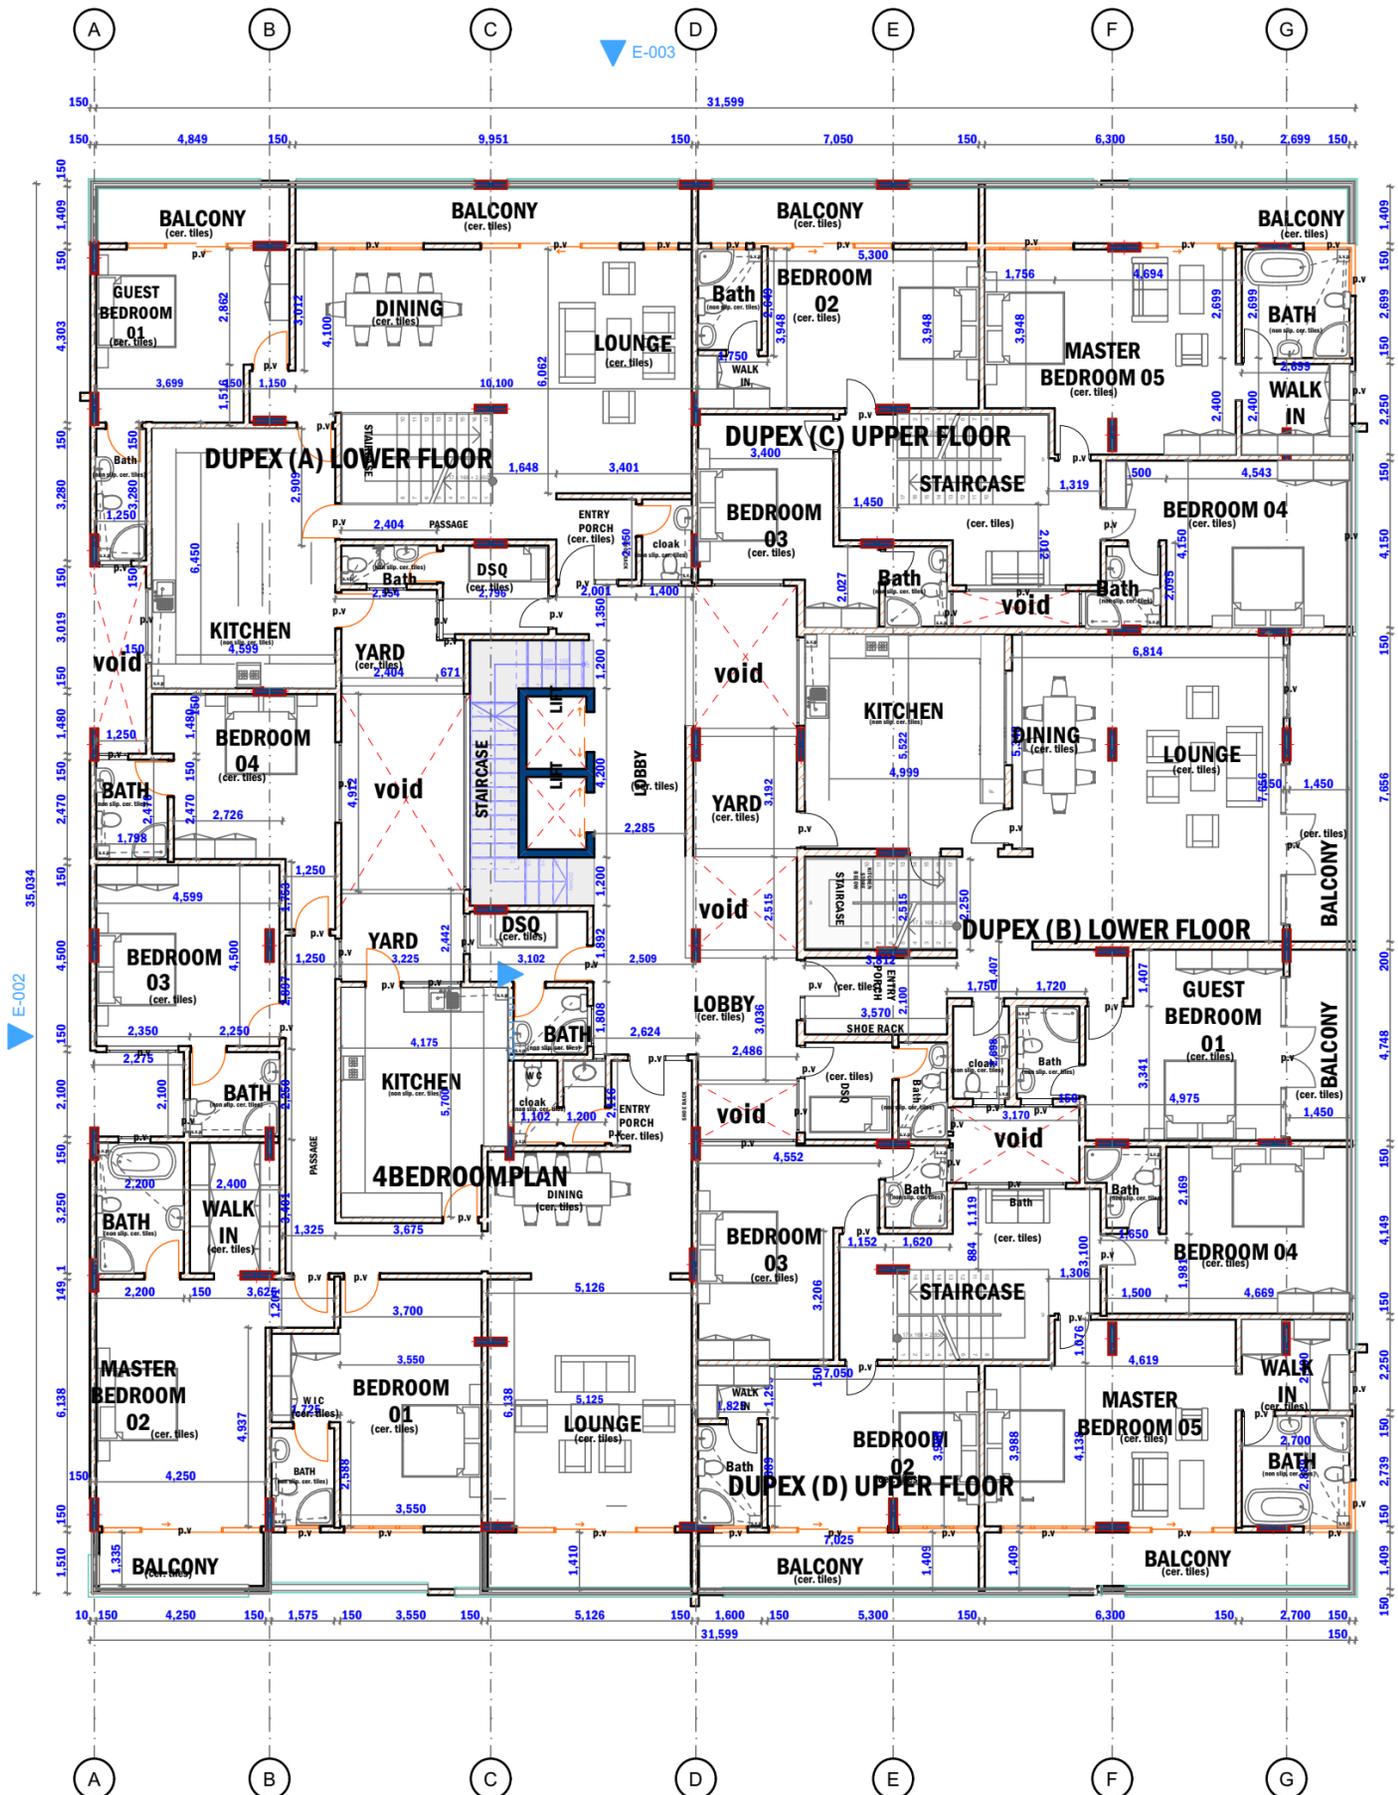

**NOTES**

- 1 This drawing is protected under the Copyright Act, and cannot be used or reproduced in part or in whole without authors consent.
- 2 All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 Provide 1 row of 600x60x50mm precast conc paving slabs around the building unless otherwise shown.
- 9 All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
- 10 Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
- 11 Plinth level to be minimum 300mm from proposed parking level or existing ground level.
- 12 All surface beds to be cast on well compacted and well consolidated filling.
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level.
- 14 All pipes and services to be minimum 450mm below reduced ground level.
- 15 All inspection chambers within building area, under building, drive-way, parking to be heavy duty double seat air-tight covers, drains pipes enclosed in 150mm concrete surround.
- 16 All parking in the Basements is mechanical Parking.

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**

**CLIENT'S SIGNATURE**


P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02) 712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR. NO 209/ 3835 ALONG THETA LANE, KILIMANI, NAIROBI FOR ADIZONE REAL ESTATE OF P.O BOX 14314 - 00610

**DRAWING TITLE**  
 3RD FLOOR  
 TYPICAL TO  
 5TH, 7TH, 9TH &  
 11TH FLOOR

**SCALE** 1:162.41

DRG. NO	REVISION
S. 09.1	DATE 11/29/2022
JOB NO	DRAWN G.K
	CHECKED S.K

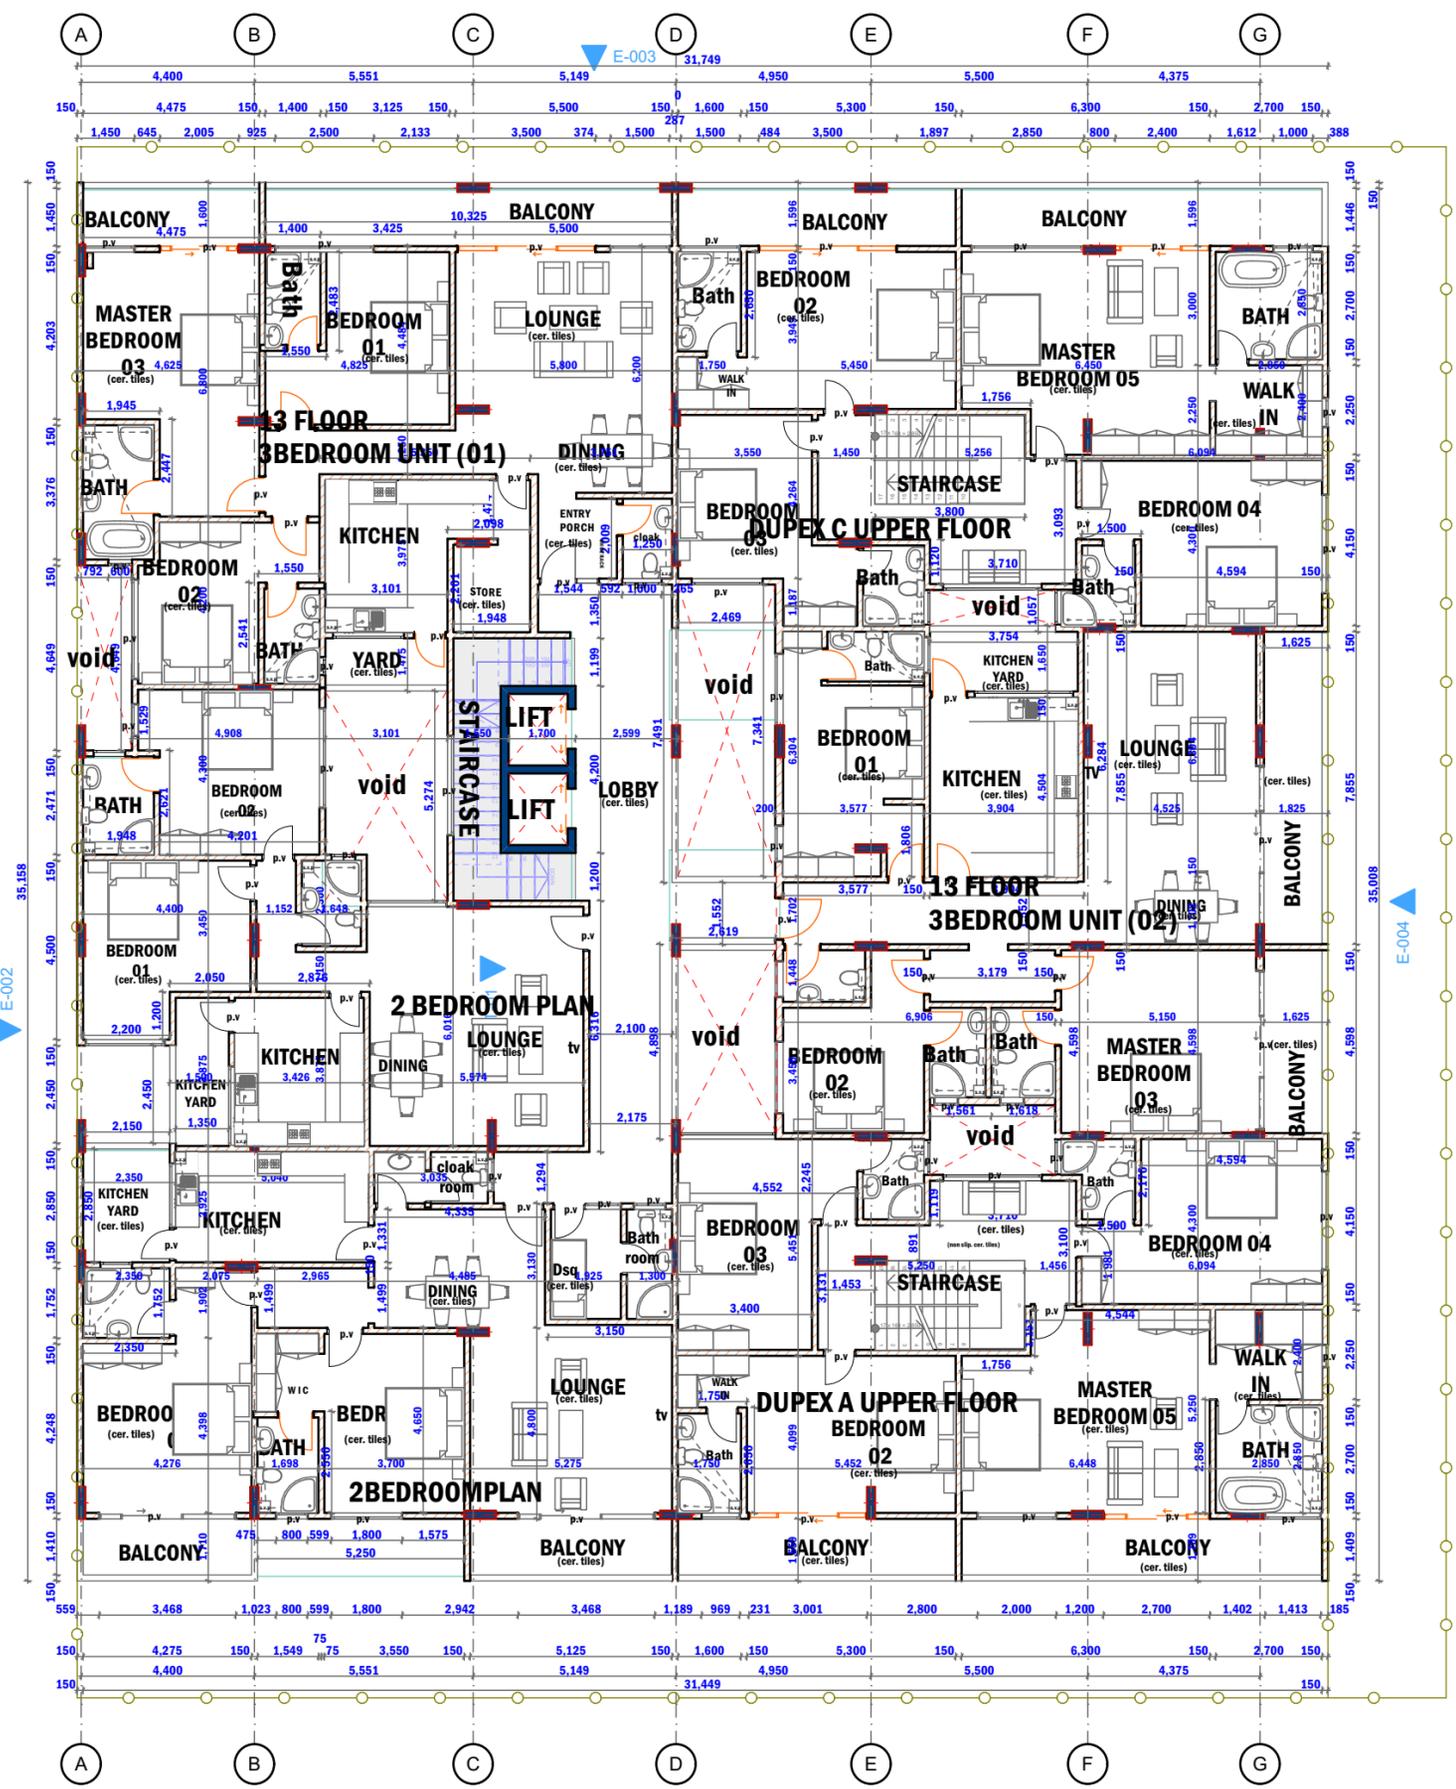

- NOTES**
- This drawing is protected under the Copyright Act and cannot be used or reproduced in part or in whole without authors consent.
  - All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
  - All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
  - P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
  - All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
  - Water Meter to be 300mm above G.L.
  - D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
  - Provide 1 row of 600x60x50mm precast conc paving slabs around the building unless otherwise shown.
  - All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
  - Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
  - Plinth level to be minimum 300mm from proposed parking level or existing ground level.
  - All surface beds to be cast on well compacted and well consolidated filling.
  - Depth of foundation trenches to be minimum 600mm below reduced ground level.
  - All pipes and services to be minimum 450mm below reduced ground level.
  - All inspection chambers within building area, under building, drive-way parking to be heavy duty double seat air-tight covers, drains pipes encased in 150mm concrete surround.
  - All parking in the Basements is mechanical Parking.

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**

**CLIENT'S SIGNATURE**


P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02)712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR. NO 209/ 3835 ALONG THETA LANE, KILIMANI, NAIROBI FOR ADIZONE REAL ESTATE OF P.O BOX 14314 - 00610

**DRAWING TITLE**  
 13TH FLOOR

**SCALE** 1:164.26

DRG. NO	REVISION
S. 09.1	DATE 11/29/2022
JOB NO	DRAWN G.K
	CHECKED S.K

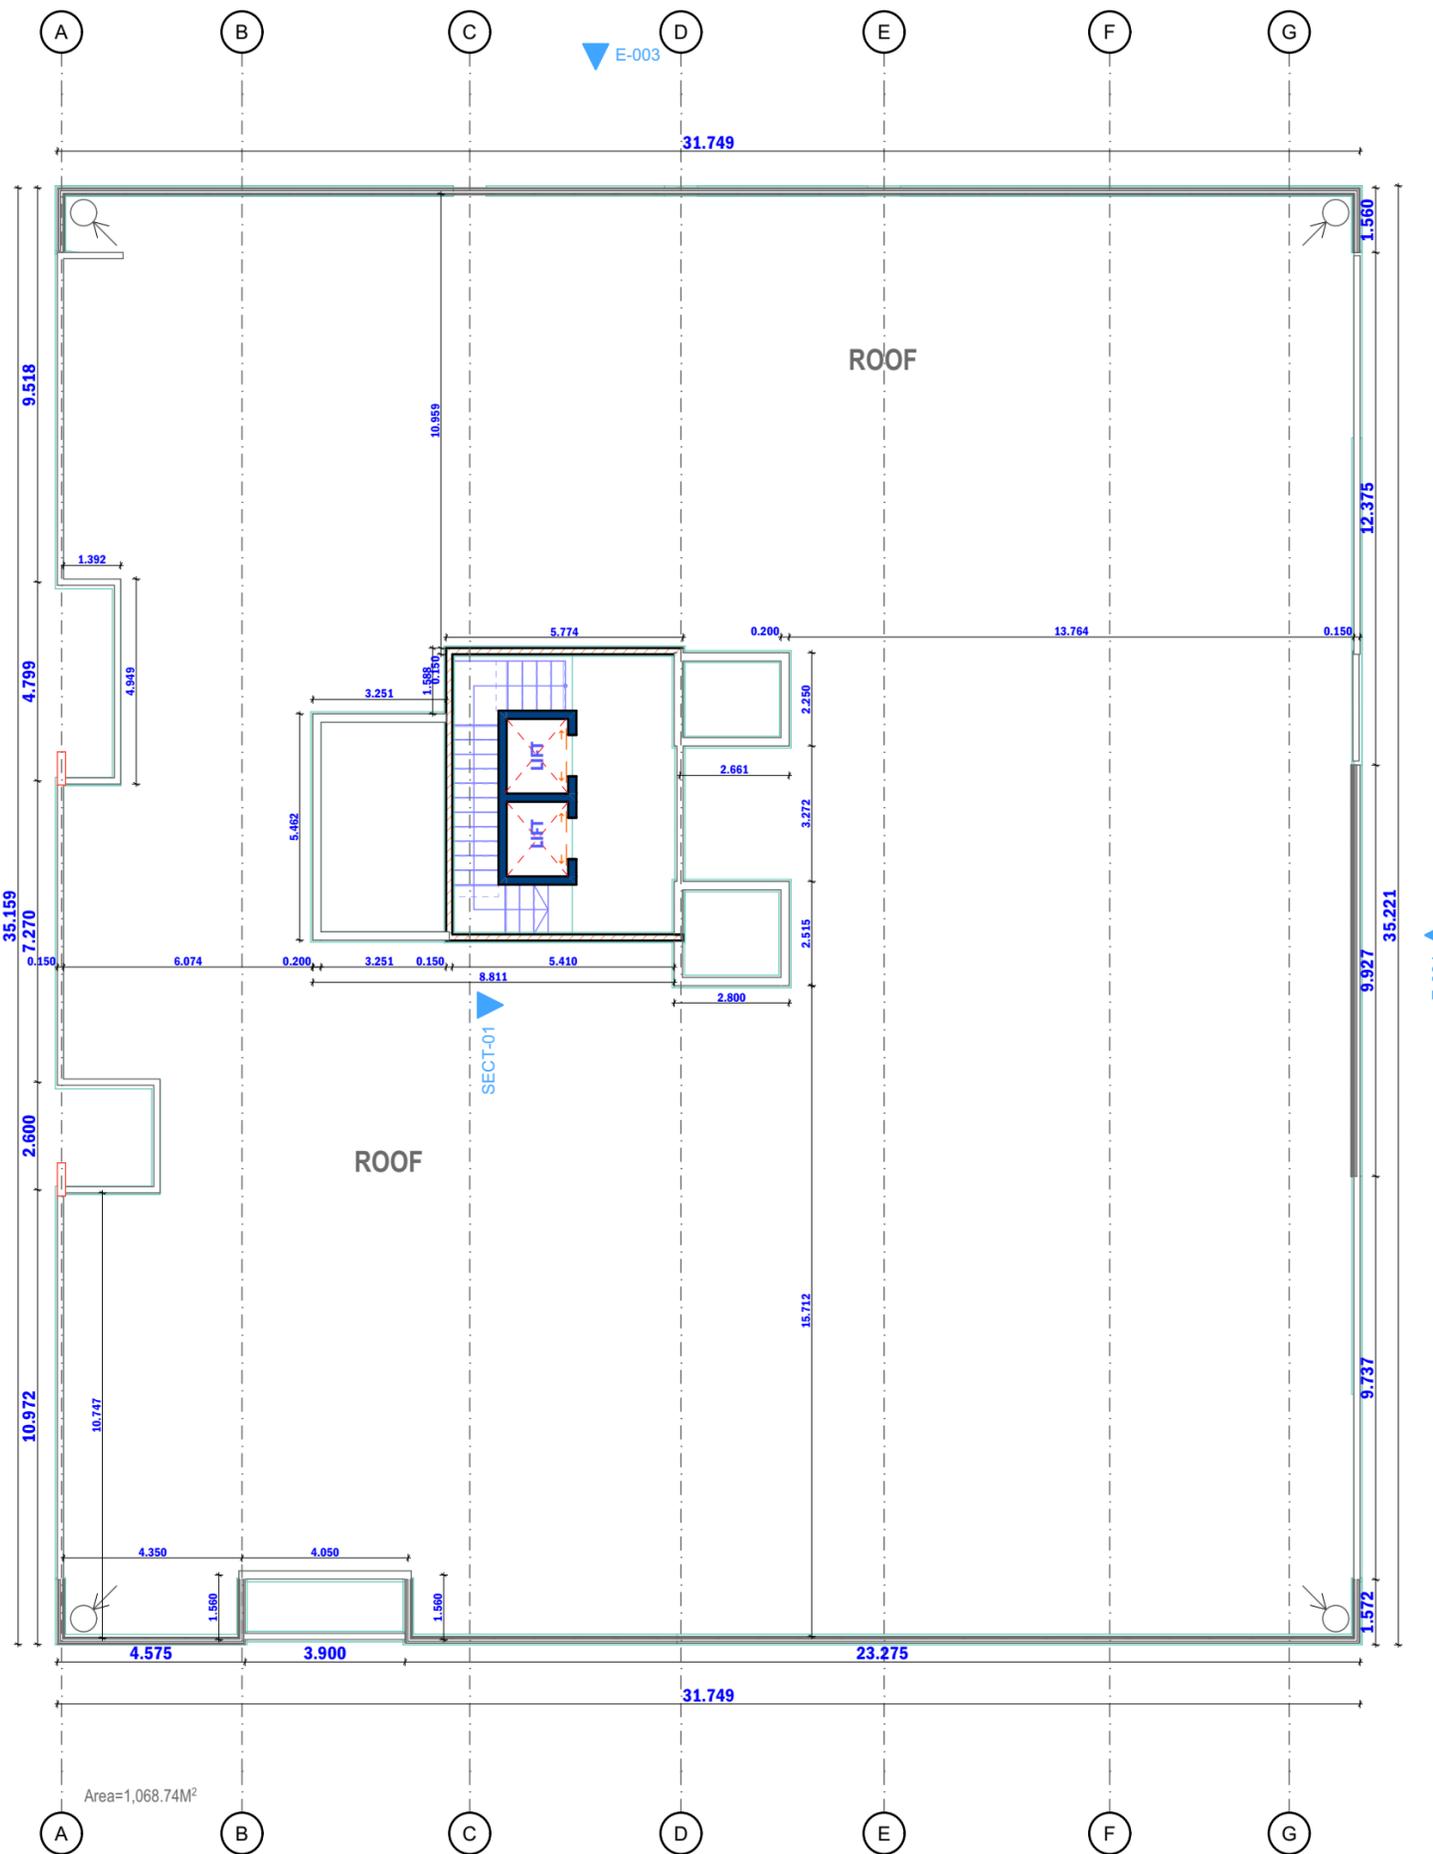

**NOTES**

- 1 This drawing is protected under the Copyright Act, and cannot be used or reproduced in part or in whole without authors consent.
- 2 All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown.
- 9 All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
- 10 Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
- 11 Plinth level to be minimum 300mm from proposed parking level or existing ground level.
- 12 All surface beds to be cast on well compacted and well consolidated filling.
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level.
- 14 All pipes and services to be minimum 450mm below reduced ground level.
- 15 All inspection chambers within building area, under building, drive-way, parking to be heavy duty double seat air-tight covers, drains pipes encased in 150mm concrete surround.
- 16 All parking in the Basements is mechanical Parking.

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**

**CLIENT'S SIGNATURE**

P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02)712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR.  
 NO 209/ 3835 ALONG THETA LANE, KILIMANI,  
 NAIROBI FOR ADIZONE REAL ESTATE OF  
 P.O BOX 14314 - 00610

**DRAWING TITLE**

**ROOF PLAN**

**SCALE** 1:157.72

<b>DRG. NO</b> S. 09.1	<b>REVISION</b>
<b>DATE</b> 11/29/2022	
<b>JOB NO</b>	<b>DRAWN</b> G.K
	<b>CHECKED</b> S.K







200mm masonry wall  
plastered and  
painted to approval

1000mm high railing  
with glass panel to  
architects approval

Steel casement  
windows to window  
schedule

200mmx450mm RC  
beams  
to S.E.'s approval

200mm masonry wall  
plastered and  
painted to approval

Steel casement  
windows to window  
schedule

200mmx450mm RC  
beams  
to S.E.'s approval

1000mm high railing  
with glass panel to  
architects approval

200mm masonry wall  
plastered and  
painted to approval

Steel casement  
windows to window  
schedule

200mmx800mm RC  
columns  
to S.E.'s approval

**NOTES**

- 1 This drawing is protected under the Copyright Act, and cannot be used or reproduced in part or in whole without authors consent.
- 2 All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course.
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown.
- 9 All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
- 10 Heavy duty polythene sheeting and anti-termite treatment to be provided under ground floor slab.
- 11 Plinth level to be minimum 300mm from proposed parking level or existing ground level.
- 12 All surface beds to be cast on well compacted and well consolidated filling.
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level.
- 14 All pipes and services to be minimum 450mm below reduced ground level.
- 15 All inspection chambers within building area, under building, drive-way, parking to be heavy duty double sea air-tight covers, drains pipes encased in 150mm concrete surround.
- 16 All parking in the Basements is mechanical Parking.

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553  
**SIGNATURE**

**CLIENT'S SIGNATURE**

P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02)712710  
 EMAIL: info@spaceedgearchitects.co.ke


**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR.  
 NO 209/ 3835 ALONG THEIA LANE, KILIMANI,  
 NAIROBI FOR ADIZONE REAL ESTATE OF  
 P.O BOX 14314 - 00610

**DRAWING TITLE**  
  
**ELEVATION 03**

SCALE 1:174.62

DRG. NO S. 09.1	REVISION
JOB NO	DATE 11/29/2022
	DRAWN G.K
	CHECKED S.K



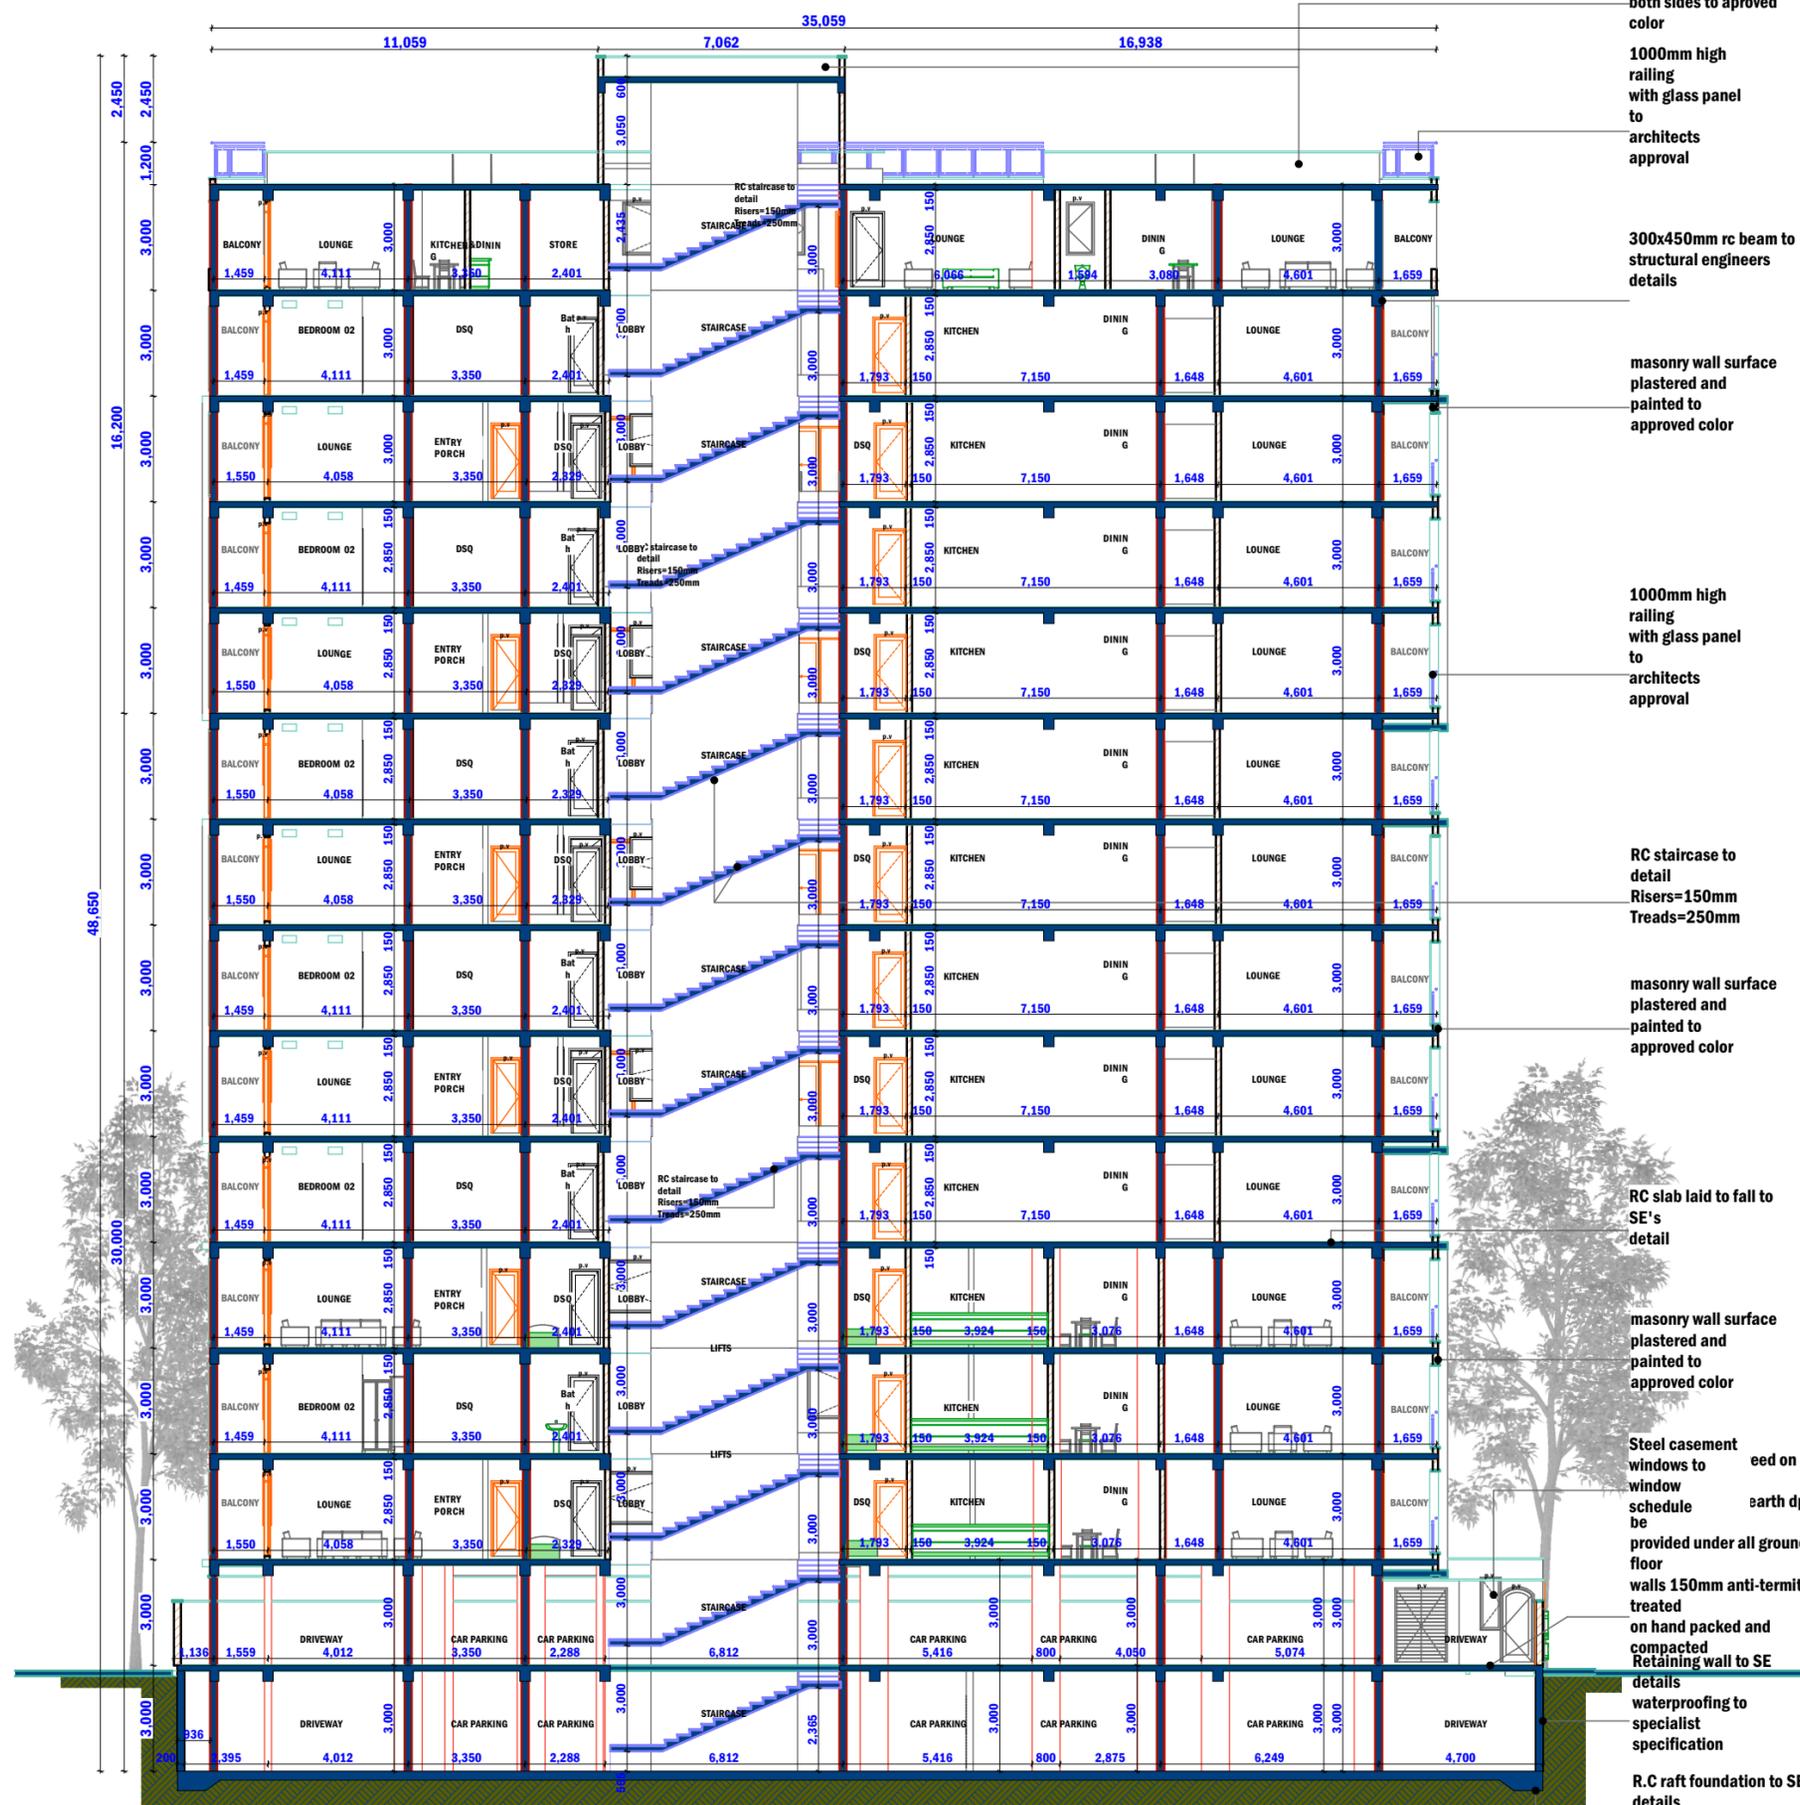

- 600mm high masonry parapet wall plastered on both sides to approved color
- 1000mm high railing with glass panel to architects approval
- 300x450mm rc beam to structural engineers details
- masonry wall surface plastered and painted to approved color
- 1000mm high railing with glass panel to architects approval
- RC staircase to detail Risers=150mm Treads=250mm
- masonry wall surface plastered and painted to approved color
- RC slab laid to fall to SE's detail
- masonry wall surface plastered and painted to approved color
- Steel casement windows to window schedule earth dpc to be provided under all ground floor walls 150mm anti-termite treated on hand packed and compacted Retaining wall to SE details waterproofing to specialist specification
- R.C raft foundation to SE details waterproofing to specialist specification

- NOTES**
- 1 This drawing is protected under the Copyright Act and cannot be used or reproduced in part or in whole without authors consent.
  - 2 All dimensions to be checked on site, written dimensions rules over scaled dimensions. Any discrepancy in dimensions to be reported to Architects before any work commences.
  - 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws and Fire regulations.
  - 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown.
  - 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
  - 6 Water Meter to be 300mm above G.L.
  - 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
  - 8 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown.
  - 9 All R.C. works to structural engineer's details. Depth of foundation to be determined on site to be not less than 1200mm.
  - 10 Heavy duty polythene sheeling and anti-termite treatment to be provided under ground floor slab.
  - 11 Plinth level to be minimum 300mm from proposed parking level or existing ground level.
  - 12 All surface beds to be cast on well compacted and well consolidated filling.
  - 13 Depth of foundation trenches to be minimum 600mm below reduced ground level.
  - 14 All pipes and services to be minimum 450mm below reduced ground level.
  - 15 All inspection chambers within building area, under building, drive-way parking to be heavy duty double seat air-tight covers, drains pipes encased in 150mm concrete surround.
  - 16 All parking in the Basements is mechanical Parking

**REVISIONS**

NO.	DATE	REVISION/ISSUE

**ARCHITECT**  
 ARCH. SOLOMON KILONZO  
 RGD. ARCHITECT-NO. A1553

**SIGNATURE**

**CLIENT'S SIGNATURE**

P.O. BOX 26783-00100, NAIROBI  
 TEL: 727296 / 722507 / 717879  
 FAX: (02)712710  
 EMAIL: info@spaceedgearchitects.co.ke

**JOB TITLE**  
 PROPOSED RESIDENTIAL DEVELOPMENT ON PLOT LR. NO 207/ 3835 ALONG THEIA LANE, KILIMANI, NAIROBI FOR ADIZONE REAL ESTATE OF P.O BOX 16314 - 00610

**DRAWING TITLE**  
 SECTION 01

SCALE 1:185.29

DRG. NO	REVISION
S. 09.1	DATE 11/29/2022
JOB NO	DRAWN
	G.K
	CHECKED S.K